



## **HTT-SP PUMPS**

### **EM-T SP PP/PVDF PUMPS (ATEX ZONE 2 VERSION)**

*Regenerative turbine pumps with magnetic drive self-priming  
in thermoplastic material*



## **INSTALLATION MANUAL, USE AND MAINTENANCE**

Translation of the original instructions

**(SAFETY INSTRUCTIONS)**

## Index

<b>1. INTRODUCTION.....</b>	<b>4</b>
1.1 General .....	4
1.2 Purpose of the Manual.....	4
1.3 Safety Alert Symbols .....	4
1.4 Qualification and training of operators .....	4
1.5 Explosion Hazard Environment.....	4
<b>2. INSTALLATION.....</b>	<b>5</b>
Premise .....	5
2.1 General Safety Warnings .....	5
2.1.1 Introduction on the danger.....	5
2.1.2 Hazard information.....	5
2.2 Receipt and Inspection.....	7
2.3 Storage.....	7
2.4 Installation.....	7
2.5 Hydraulic system .....	7
2.6 Pipes Connection .....	8
2.7 Monitoring equipment .....	8
2.7.1 Checking the pump in ATEX ZONE 2 explosive environments.....	9
2.8 Motor connection.....	10
<b>3. OPERATION .....</b>	<b>11</b>
3.1 Use and Safety .....	11
3.2 First start .....	12
3.3 Temperature.....	12
3.4 Before Starting.....	12
3.5 Start-up .....	12
3.6 Optimal conditions of use .....	13
3.7 Shut down.....	14
3.8 Long pump inactivity .....	14
3.9 Noise Level.....	14
<b>4. MAINTENANCE .....</b>	<b>14</b>
4.1 General provisions.....	14
4.2 Inspections .....	15
4.3 Main Parts .....	16

4.4 Disassembly .....	17
4.4.1 Procedure Before Disassembly .....	17
4.4.2 Disconnection of the pump from the motor .....	18
4.4.3 Disassembling Pump Components .....	18
4.4.4. Internal disassembly of the pump .....	19
4.5 Pump Reassembly .....	19
4.6 Replacing the motor .....	20
4.7 Tightening Torques .....	20
<b>5. PROBLEM SOLUTIONS .....</b>	<b>21</b>
<b>6. SPARE PARTS &amp; ACCESSORIES .....</b>	<b>22</b>
6.1 How to order spare parts and accessories .....	22
<b>7. DATA .....</b>	<b>22</b>
7.1 Performance curves .....	22
7.2 Dimensions .....	23
7.3 Technical data and limits .....	24
<b>8. WARRANTY AND REPAIR .....</b>	<b>24</b>
8.1 Warranty .....	24
8.2 Returned parts and repair .....	25
8.3 Decontamination Declaration (facsimile) .....	26
8.4 CE CERTIFICATE FOR PUMPS SERIES HTT .....	27
8.5 ATEX/CE Certificate for Zone 2 (facsimile) .....	28

## 1. INTRODUCTION

### 1.1 General

This manual refers to the family of magnetic drive centrifugal pumps of the HTT SP Self-priming model. The pumps of this family are built in thermoplastic material Polypropylene or PVDF and in different sizes. The dimensions and powers available are described in paragraph 7.0.

### 1.2 Purpose of the Manual

The primary purpose of the manual is to ensure that the installation, use and maintenance activities of the pumps are carried out correctly and safely by the various operators responsible for these operations. The document also provides the customer with useful information for diagnosing problems, finding spare parts and accessing the repair service offered by GemmeCotti srl

ATTENTION: check on the website [www.gemmecotti.com](http://www.gemmecotti.com) if subsequent revisions to this manual have been released.

### 1.3 Safety Alert Symbols



This symbol indicates possible dangers induced by the presence of electric fields, contacts or wires with electric voltage.



Exclamation point signals in this manual indicate a particularly important situation that requires attention from the operator. In particular, they are useful indications for correct operation and for the prevention of possible damage to the devices.



This symbol indicates the presence of strong magnetic fields that may damage or impair the operation of other devices if placed nearby. SUCH AS PACEMAKERS, QUARTZ WATCHES, DIAGNOSTIC EQUIPMENT ETC. SEE SECTION 2.1.2 FOR MORE DETAILS



This symbol indicates a danger or a situation which requires the utmost attention on the part of the operator. It is essential to respect the instructions given on the sidelines of this symbol and to proceed with the utmost caution. It is necessary to inform all operators and/or users that the rules indicated prevent accidents.

### 1.4 Qualification and training of operators



The personnel responsible for the installation, use and maintenance of the pumps must be qualified to carry out the operations indicated in this manual. GemmeCotti cannot be held responsible for the insufficient level of preparation and training of the customer's personnel and for the fact that they were not made aware of the contents of this manual. It is essential to always provide this manual to the operators assigned to install, use and maintain the pump. Keep this manual in a safe place for future reference.

### 1.5 Explosion Hazard Environment

The pumps described in this manual cannot be used in environments with danger of explosions. For this type of use, special pumps built by GemmeCotti with particular materials

and devices are required. The customer who intends to use special pumps in this type of environment must consult the GemmeCotti technical office for a correct choice of the article.

The pump models, built by GemmeCotti, for this type of applications are distinguishable by the acronym EM-CO or EM-C or EM-T or EM-P.

Model EM-C, EM-T and EM-P pumps in PP or PVDF can only be installed in ATEX zone 2 group II category 3 G Ex h IIB T6 Gc. Refer to paragraph 2.7.1. for more information.



**WE REMIND YOU THAT THE CLASSIFICATION OF THE ZONE (REF. ATEX 2014/34/EU FORMER 94/9/CE DIRECTIVE) FOR POTENTIALLY EXPLOSIVE ATMOSPHERE ZONES HAVE TO BE DONE BY THE CUSTOMER AND COMMUNICATED TO GEMMECOTTI FOR THE RIGHT CHOICE OF THE TYPE OF PUMP SUITABLE TO WORK IN THESE ZONES.**

It is also the customer's responsibility to correctly install the pump in accordance with the requirements set out in the Directive

## 2. INSTALLATION

### *Premise*

All references made to pumps are to be considered applicable to systems using these pumps unless otherwise specified.

### **2.1 General Safety Warnings <sup>1</sup>**

#### **2.1.1 Introduction on the danger**



**ATTENTION :** Failure to observe the indications given in this manual or the improper use of the equipment by unqualified and unauthorized personnel could cause serious personal injury or death and damage to products and things!

The technical assistance service is at your complete disposal; for any doubts or problems, you can contact us by telephone on +39 02 964.60.406 or write an email to [info@gemmecotti.com](mailto:info@gemmecotti.com). We strongly recommend that you keep GemmeCotti's written response

#### **2.1.2 Hazard information**



For the safety of the operators involved in the installation operations, it is necessary to use protective clothing and personal protective equipment approved in accordance with the provisions of the law in force (ie safety goggles, gloves and insulating and protective footwear against crushing).



The pump contains particularly powerful magnets. It is forbidden for personnel with cardiac pacemakers, defibrillators, electronic medical devices, metal heart valves, metal prostheses or sickle cell anemia to handle or be in the vicinity of the magnets contained inside the pumps. Consult an occupational physician for specific recommendations before working with these pumps.

<sup>1</sup> Failure to follow the warnings provided may void the Pump Certification and Warranty



The strong magnetic fields present in the vicinity of the pumps can damage heart pacemakers, watches, credit cards, disks and magnetic tapes inside computers and computers.



When working near pumps, be aware that tools or metal parts handled can suddenly be attracted to the pump body, possibly causing crushing fingers or hands.



These pumps have been designed and built for use in specific conditions and within defined limits. Use outside of these specifications must be agreed and approved by GemmeCotti's technical service. **It must be borne in mind that if pumps are used outside of their technical specifications, the CE Certification and Warranties are void. Furthermore, if the pump is used outside the technical specifications communicated in the quote phase and confirmed with our order confirmation, the user assumes all responsibility for the CE certification of the product.**



The pump must be used only in the applications, conditions (temperature, pumped liquid) and characteristics (flow rate and head) specified in the GemmeCotti proposal and confirmed with the order confirmation, for which GemmeCotti has selected the model, the construction materials and tested the pump to comply with its specifications. for any use other than what is communicated with the order confirmation, a written request must always be made to the technical department of GemmeCotti which in turn will respond in writing.



No guarantee is provided for repairs or alterations made to the product by users or by third party personnel not specifically authorized by GemmeCotti.



Always stop the pump before touching it or carrying out any work on it or in the installation circuit.

Make sure that the electrical network to which the pump will be connected has adequate power and has the correct protection devices (ie earthing, circuit breaker).

Always disconnect the power supply before working on the pump for maintenance or replacement of parts.



Always keep a fire extinguisher near the pump installation.

Always use extreme caution when performing maintenance tasks on pumps and attached circuits when used with hazardous liquids. **PERSONNEL WHO INTERVENE MUST BE PROPERLY TRAINED ON POTENTIAL HAZARDS**



The use of an electric starter is recommended. A simple switch may not be sufficient to start and stop the electric motor connected to the main power line. An appropriate starter:

- allows you to prevent accidental starts after a failed start attempt;
- provides a safe switch, protected against water;
- protects the electric motor against short-circuit overloads (a fuse only protects the wires);
- resists overloaded starts on the motor, preventing dangerous arcing and premature wear of the electrical contacts.

## 2.2 Receipt and Inspection

Although all precautions have been taken before packing, we advise you to carefully check the material received. Review all items on the packing list. Make a written report immediately for any damage or shortages attributable to the carrier and/or GemmeCotti.

Check the plate data of the pump received and compare them with those relating to your purchase order.

If the pump came with the motor, remove the motor fan shield and try turning the motor shaft by hand. If you feel strong resistance to rotation or if you hear abnormal noises, call your trusted dealer or the GemmeCotti assistance service directly.

## 2.3 Storage



If the pump is placed in the warehouse, make sure that this takes place in a dry and sheltered place; always use the original packaging or equivalent protection. Should the pump be left in the warehouse for very long periods and/or in particularly humid environments, the use of hygroscopic substances ( silica gel) is recommended to prevent damage.



Do not remove the flange protections until installation and close, if not already closed, the holes of the intake/delivery manifolds and the air connection to prevent the intrusion of foreign bodies.



It is warned that a prolonged storage time of the pumps can cause:

- degradation of motor insulation due to moisture absorption
- seal degradation

After prolonged storage, before commissioning, it is a good idea to check the tightness of all the bolts of the pump and between the pump and the electric motor. Check for oxidation of the electrical contacts in the motor box

## 2.4 Installation



GemmeCotti srl cannot be held responsible for damage to persons or objects caused by improper installation or by unqualified personnel.

Install the pump in a location that allows for easy service.



The motor/pump unit must be fixed to a rigid structure which allows the entire structure to rest. Make sure that the pump is fixed on a surface, if necessary use the bases supplied by GemmeCotti or wedges under the motor support bases. Where deemed necessary, use "bumpers" to reduce vibrations towards the fixing surface.

The pump must be installed horizontally. IF THE PUMP IS NOT INSTALLED HORIZONTALLY, IT CANNOT WORK

## 2.5 Hydraulic system

The pump is generally part of a hydraulic system that can include a number of components such as valves, equipment, filters, expansion joints, tools, etc. The way the implant is performed and the placement of its components has a great influence on the operation and life of the pump.



It is advisable to wash the new systems internally before installing the pump to remove any processing residues to prevent them from entering it and damaging it.

## 2.6 Pipes Connection <sup>2</sup>



Locate the pump as near as possible to the liquid source and under the level of the liquid (under head).



Always use pipes as short and straight as possible and limit the number of bends assuring radius of curvature as large as possible. Avoid turbulence and air siphon that can be created in the long piping line. Avoid the creation of siphon also before the suction of the pump.



The pipes must be supported and kept in line independently from the pump, up to its connections, so as not to weigh on it.



The diameter of the suction hose must be equal to the diameter of the suction connection of the pump. The diameter of the discharge pipe must be equal to or greater than the diameter of the discharge connection. **Caution:** To allow the pump to be primed, neither the suction nor the discharge must be intercepted. Narrowing on the suction pipe is responsible for and causes cavitation of the pump, leading to a loss of efficiency and rapid wear. It is recommended to always use reinforced hoses that do not collapse in a vacuum situation. **THE DISCHARGE MUST BE FREE WITHOUT SHUT-OFFS TO ALLOW THE PUMP TO BE VENTED DURING PRIMING. IF THIS DOES NOT HAPPEN, THE PUMP WILL NOT WORK.**

The liquid to be pumped must be free from slag or foreign particles.  
Never couple metal pipes to plastic pumps.

Tightening the pipes on plastic pumps must be done without the use of tools.  
Make sure that the connections are carefully tightened and watertight otherwise the suction capacity will be reduced.

A vacuum gauge should be installed on the suction pipe near the pump, while a pressure gauge should be installed on the delivery pipe. The installation of these tools will allow the operator to easily check the correct functioning of the pump in relation to the required operating point. In the event of cavitation or other malfunctions, noticeable pressure fluctuations will be observed.

## 2.7 Monitoring equipment

Depending on the importance of the pumping circuit, it may be useful to maintain close control over the performance and conditions of the process. The use of instruments for measuring pressure on the suction and discharge circuits may be recommended.

The measurement of the electrical power absorbed by the motor can also be measured by means of the use of a wattmeter.



If the temperature of the pumped liquid can represent a critical element, insert a thermometer in the circuit, preferably on the suction line.

These control instruments can warn of any anomalous pump operating situations such as: accidentally closed valves, missing liquid, overloads, etc.

**Caution:** the pump will not prime if the suction and/or discharge lines are intercepted.

<sup>2</sup> Failure to follow the warnings provided may void the warranty terms on the pumps supplied.



BEFORE COMMISSIONING THE SELF-PRIMING PUMP, CHECK THAT THE SUCTION PIPING AND THE CONNECTIONS TO THE PUMP ARE WATERTIGHT. THE OUTLET MUST BE OPEN WITHOUT SHUT-OFFS TO ALLOW THE EVACUATION OF THE AIR IN THE INTAKE WHICH ALLOWS PRIMING

### 2.7.1 Checking the pump in ATEX ZONE 2 explosive environments

In addition to respecting the general warnings stated in this manual, special pumps used in potentially explosive areas have to be installed with control equipment specified in this paragraph to maintain a strict monitoring of the performances and process conditions. The control equipment mounted near the pump has to be certified for the same hazardous zone as the pump installed unless it's protected by an airtight closure cabinet also certified

The installation of pumps type EM-(C-T-P) for use in potentially explosive areas has to follow the rules stated in the ATEX Directive 2014/34/UE.

In particular the requirements referred to the manufacturer applicable to apparatus of **Category 3 of Group II** (explosive atmosphere due to gas, vapours or mists presence) are the following:

- the devices have to be designed and manufactured so that they avoid trigger sources predictable during normal functioning.
- During expected functioning conditions, the surface temperatures must not exceed the maximum temperatures indicated (paragraph 3.1). An eventual overcoming is endurable, in exceptional cases, if the manufacturer adopts extra special protections.

The temperature classes are as follows:

Temperature classes according to ISO80079-36	Liquid temperature limits
T6 (85°C)	60°C
T5 (100°C)	75°C
T4 (135°C)	110°C
T3 (200°C)	175°C

- Ambient temperature should be between -20°C and 40°C as per ISO 80079-36
- Fluid temperature has to be measured at the suction port
- Attention: the chart with the range of temperature is valid only in optimal conditions of use of the pumps (rpm, capacity, head and NPSHa), with correct lubrication and maintenance.
- In any case, the fluid temperature must not exceed the pump's maximum or minimum design temperature (see section 3.1)



It is not recommended to mount the suction filter to avoid obstruction to the suction of the pump which can cause cavitation and/or dry running. A suction filter can only be useful during the start-up phase, for cleaning the same and in any case it must be monitored to avoid clogging that would lead to the correct operation of the pump



If unacceptable working conditions are revealed, the pump has to be automatically stopped and checked



NPSHa can decrease in case of installation of a valve in the suction line. In this case, it is necessary to install a flowmeter to check possible variations.



The pump is equipped with a conductive ring and so with an accurate ground connection of the ring there can't be unwanted electrostatic charges, sources of explosion trigger.



Pumps supplied for ATEX zone 2 must be coupled to suitable Ex-proof motors.

## 2.8 Motor connection



Check that the voltage and frequency shown on the motor label correspond to those of the electrical network you are to use.

Never connect the electric motor directly to the main line but protect the dedicated line with a suitable main switch with adequate safety and overload protections.



Electrical connections must always be carried out by a qualified expert electrician. Check the voltage, number of phases on the motor plate and proceed accordingly with the adequate electrical connection. The type of connection in three-phase motors can be star (  $\square$  ) or delta (  $\Delta$  ) according to the 400 or 230 VAC power line (see figure 1).



Figure 1



Make sure that the sense of rotation of the motor is that specified on the pump head and eventually indicated by a sticker arrow on the motor fan; to change the sense of rotation it's sufficient to change two of the three entering line (E.g. L1 with L2) in three-phase motors.



Read the following instructions to change the sense of rotation:

- wear approved personal protective equipment (i.e. glasses, gloves)
- ensure that the conditions of use comply with the pump specifications (see paragraph 7)
- install the pump in the hydraulic system
- fully open the suction and discharge lines. **Warning** : The suction and/or delivery line must not be intercepted otherwise the pump will not prime.
- Fill the pump body with the first filling liquid. **Warning** : the pump will not prime if the pump body is not filled from the cap up to its hole . It is advisable to carry out this test with an inert liquid such as water, if compatible with the process.
- never allow the pump to run dry (NB the design of the pump with magnetic drive does not allow dry running as this would irreparably damage the internal components of the pump)
- power the motor only for one or two seconds to observe the direction of rotation which complies with the arrow placed on the motor and on the pump and indicated on the technical drawings of the pumps. (clockwise looking at the front of the pump and counterclockwise looking at the motor fan)

**NOTE:** A pump running in the opposite direction will still pump but with a flow and pressure much lower than the data on the plate. If a direction of rotation opposite to the expected is detected, reverse two of the three input lines as described above

### 3. OPERATION

#### 3.1 Use and Safety

##### ATTENTION:

Dangerous or hazardous actions can cause serious injuries or death to people or serious damage to materials and so it's important to assure the respect of all the warnings relative to the safety and the correct use written in this manual



Always check that the fluid being pumped is compatible with the construction materials of the pump. For any clarifications, contact the GemmeCotti technical office.



When used for pumping aggressive, toxic or health-hazardous liquids, it is generally necessary to install on the pump adequate protection for the containment, collection and signaling of the dangerous product in the event of leakage: Ex. POLLUTION DANGER , CONTAMINATION, INJURY AND/OR DEATH.



Due to the materials of which the pumps are made, there is the possibility of the onset of electrostatic charges which must be dissipated by means of suitable earthing.



Do not pump liquids containing solids in suspension. Mag drive pumps are designed to pump clean liquids. It is NOT recommended to mount the filter on the suction line to avoid obstruction of the suction of the pump which can cause cavitation and/or dry running. A suction filter can only be useful in the start-up phase of the system, for cleaning it, and in any case it must be monitored to avoid blockages which would lead to the incorrect functioning of the pump. Avoid, in particular, pumping liquids containing ferro oxides or other ferromagnetic particles, even if small. If you are in doubt, please call GemmeCotti technical service (tel. +390296460406).



Never restrict the suction. Restrictions on the inlet are responsible for pump cavitation, which leads to a loss of efficiency and rapid wear. Restrictions on the delivery are not advisable, reductions in the flow rate, if required, can be obtained by means of a valve installed on the delivery pipe.



Never loosen the pump connections while it is under pressure.



Do not start and/or operate the pump if there are traces of leaks in the circuit.



The operating temperatures must be such as to respect the characteristics of the construction materials used in the pump:

- 0- 60 °C execution in polypropylene (PP)
- 0- 80 °C execution in PVDF



**DO NOT ALLOW THE PUMP TO RUN DRY** (note: the mag drive pump design doesn't allow the dry-running functioning because it will damage irrevocably the inner parts of the

pump)



An accidental failure can generate spray up to a considerable distance.



In the event of abnormal vibrations or noises, stop the pump immediately.



Do not pump flammable liquids.



Do not touch the pump while it is running.



Switch off the power before touching the motor or lantern

### 3.2 First start



Fill the pump with water (if compatible with the process liquid) or with the liquid to be pumped before starting it. This will protect the bushings and pump shaft against dry running. **NEVER RUN THE PUMP DRY** as serious damage can be caused due to lack of the necessary lubrication to the internal components of the pump itself.

### 3.3 Temperature



Increasing the temperature of the fluid moved can damage the pump and/or the system pipes and can cause a situation of serious danger for people in the vicinity. Avoid sudden jumps in temperature and do not exceed the temperatures specified in the order, or the limits shown in the technical data sheets available on the web page. See the temperature values of the pump construction materials in paragraph 3.1.

### 3.4 Before Starting

Be sure that the pump is installed in accordance with the instructions provided in section 2 above.




**Caution:** The pump casing must be filled with liquid to allow priming. The suction and delivery pipes must never be intercepted otherwise the pump will not prime

**ATTENTION: ALL THE PUMPS ARE TESTED WITH WATER** , it is therefore possible that there are small residuals of water; if the **LIQUID TO BE PUMPED IS INCOMPATIBLE WITH WATER** , or if the **SYSTEM** where the pump is installed **COULD BE DAMAGED** by the presence of water, **IT IS NECESSARY TO ACCURATELY DRY THE PUMP WITH AIR AT A TEMPERATURE NOT HIGHER 35°C.**

### 3.5 Start-up

Make sure that the pump body has been filled with water up to the filler cap. If the water is not compatible with the process, provide for filling with a compatible inert liquid having the same specific weight and viscosity characteristics as water. Once the pump has been filled, tighten the filler cap with the relative OR and make sure that it is watertight.

**Make sure** that the suction and discharge pipes are not intercepted otherwise the pump will not prime. The delivery pipe must be connected to a container whose pressure is the same as that of the container for the liquid to be sucked in. Higher pressures in the delivery container do not allow the air to be evacuated from the suction pipe, not allowing the priming of the pump, when the two tanks must be put in communication.

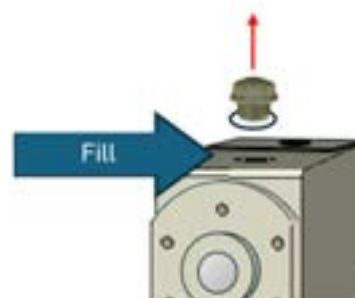

In the case of suction tanks at atmospheric pressure, the delivery pipe must be connected to an open container with the atmosphere. If the delivery vessel is closed, it will be under slight pressure during the priming phase, inhibiting the priming of the pump.

Make sure that the suction line is as short as possible and vertical.

The priming of the pump has physical limits, due primarily to the atmospheric pressure and the temperature of the liquid to be pumped. The atmospheric pressure decreases as the altitude at which the pump is installed increases.

By way of example, the pump at sea level with water at 15 degrees can be primed up to a height of 6-7 meters. The same pump, mounted on a plant in a mountainous area at an altitude of 2000 meters, will be adapted to much lower heights. Contact the gemmecotti technical office for more information.

Start the electric motor and check the correct direction of rotation of the motor

Check the priming times with the graph at the end of this manual.



**Warning :** Liquids with a specific weight greater than 1Kg/dm<sup>3</sup> and altitudes higher than sea level lengthen the priming times compared to those shown in the graph.

With primed pump, if the pressure indicated by the outlet control instruments does not increase, switch off the pump immediately and release the pressure gradually.

Carefully check the tightness of the entire suction part of the pump (suction pipes and fittings, pump suction pipe connection, filler cap)



**Attention:** The suction pipe must be at least 50cm below the free surface

Once the above checks have been carried out, repeat the pump starting operations.

If during the start-up phase there are changes in the flow velocity, density, temperature or viscosity of the liquid, stop the pump and contact with the technical assistance service of GemmeCotti srl.

### 3.6 Optimal conditions of use

Operating continuously at the far end right side of the pump performances curve (maximum pressure with valve fully closed or maximum flow rate with valve fully open at the bottom of the curve) there can be an early wear of the pump. As a general rule, we recommend using the pump at half of its maximum capacity (see the paragraph relative to the technical data)

In any case do not allow the pump to work out of curve.



The characteristic curve of the pump, showing flow rate and head, refers to pumping of water at room temperature. If liquids at high temperatures or high viscosities and densities have to be pumped, the performances must be correspondingly reduced. The HTM series pumps work well with liquids having viscosities up to 100 CPS and specific gravities up to 1.9 kg/dm<sup>3</sup>. **IN ANY CASE BOTH THE VISCOSITY AND THE SPECIFIC WEIGHT MUST BE COMMUNICATED DURING THE QUOTATION REQUEST PHASE**, the electric

motor is selected for the communicated viscosity and specific weight, if they are higher, the engine power could be insufficient

### 3.7 Shut down

Normally the pump should be shut down only after closing the delivery valve. If the suction valve is closed before the other, cavitation of the pump can occur.

If the suction is under swing (flooded), close the valve after shutting down the pump.



In some cases the pump can be used to empty tanks, in these situations the liquid can stop flowing in the pump while this is still working. In these cases a pump operating without liquids (that means dry-running) can be dangerously damaged if it's not stopped immediately. For such applications the use of automatic equipment or the constant presence of a person who can shut down the pump is recommended.

### 3.8 Long pump inactivity



If the pump has to remain inactive for a long period, before stopping it, it's recommended to let water flow in the system for several minutes so that you avoid any risk of internal deposits or sediments or precipitations of solid parts. Drain the liquid in the pump. An eventual freezing of the liquid inside the pump can cause damage. Always verify if the pumped liquid reacts with water. In this case contact GemmeCotti to find an alternative solution

In cases where the pump is temporarily removed from the system and stored, the instructions provided in paragraph 2.3 "Storage" must be followed.

### 3.9 Noise Level

In some circumstances, for example when the pump works with high pressure and low flow rate, the noise increases and can be annoying for the personnel working nearby. In this case it is possible to intervene with:



- Earplugs;
- approved protective ear defenders ;
- soundproofing devices for the pump. In these cases, make sure that the motor ventilation is guaranteed .
- 

## 4. MAINTENANCE

### 4.1 General provisions



During the warranty period, no extraordinary maintenance operations on the pump must be performed except by GemmeCotti personnel or those authorized by GemmeCotti. All the operations described in the following paragraphs must only be carried out by suitably qualified personnel and following all the warnings included in this manual step by step .

In case of routine maintenance of the pump (as indicated in paragraph 4.2) the customer is responsible for the correct disassembly and assembly. The pump warranty is void in the event of tampering with it, use of non-original parts or in the event of practices that do not comply with the instructions in this manual.

During ordinary maintenance of the pump, the customer is responsible for checking the seals (via hydrostatic test, taking care to respect the PN - nominal pressure - of the pump), impeller/magnet alignment, positioning of the shaft, assembly of bushes and control of good functioning of the pump. To tighten the screws, refer to the values given in paragraph 6.1 and be careful not to pinch the O-ring.

Clean the external surface of the pumps using antistatic devices only.



Any operation carried out on the pump must be carried out only after having physically disconnected the power supply.



Handling of pumps weighing more than 16 kg must not be done manually, but only using hoists or other suitable means. When moving the pump or parts of it, avoid blows or falls that could damage the devices.



Before proceeding to disassemble any parts of the pump, make sure that the dangerous internal liquids have been properly removed / flushed out. **THE PUMP MUST BE CLEANED.**



Pay attention that some internal liquids could have dangerous reactions in contact with water.



When discharging dangerous liquids, make sure that there are no dangerous situations for people or the environment.

## 4.2 Inspections

In general, magnetic drive pumps do not require frequent maintenance or disassembly. However, periodic inspections are advisable to check the state of wear of the impeller, shaft, O-rings and bushings and if the general conditions of the internal parts of the pump are good.

The inspection interval strongly depends on the operating conditions of the pump, on the characteristics of the fluid, temperature, materials used and of course on the operating time.

After the first start-up it is advisable to check the bushings after 3 months. If the check is successful, it is advisable to carry out a further check after another 6 months. The next inspection is recommended after one year of operation (about 2000 hours). In any case, it is good practice to replace the PTFEC bushings every 2000 hours of pump operation.


The other components should only be changed when they show clear signs of wear.

If a problem has been found or the pump needs a complete inspection see the chapters “Troubleshooting” and “Pump disassembly”.



### 4.3 Main Parts

The drawings below and FIG 1 show a section with the bill of components and an exploded view of the parts constituting a pump of the HTT-SP family in thermoplastic material.

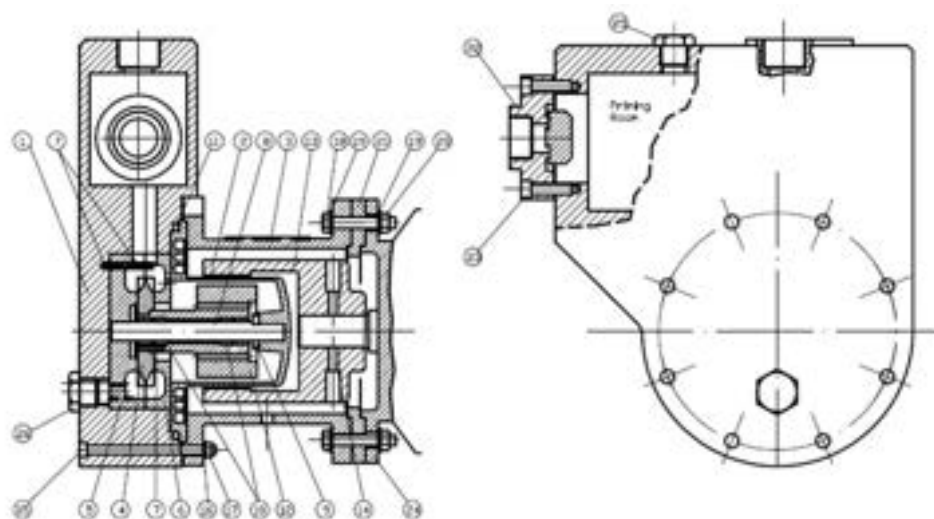

POS.	DESCR.	MAT.
1	CORPO POMPA	Pump head PP/PVDF
2	BOCCHERE	Rear Casing PP+GF/PVDF+GF
3	LANTERNA	Bracket PP/PVDF
4	GERANTE	Impeller PVDF
5	DISCO SUPERIORE	Front Disc PP/PVDF
6	DISCO INFERIORE	Rear Disc PP/PVDF
7	SPINA	Pin PP/PVDF
8	ALBERO	Shaft A203 95.7%
9	ANELLO	Ring A203 95.7%
10	BOCCOLA	Bearing PTFE
11	O-RING	O-Ring EPDM/VITON
12	MAGNETE INTERNO	Int. Magnet PP/PVDF
13	MAGNETE ESTERNO	Ext. Magnet C40

POS.	DESCR.	MAT.	
14	GRAND	Screw	A2
15	VITE M6x90	Screw M6	A2
16	RODIELLA Ø6.5	Washer Ø6.5	A2
17	SAPO M6	Nut M6	A2
18	VITE M6x40+50	Screw M6	A2
19	RODIELLA Ø8.5	Washer Ø8.5	A2
20	SAPO M8	Nut M8	A2
* 21	FLANGIA MOTORE	Motor Flange	PP/PVDF
22	FLANGIA VALVOLA	Valve	PP/PVDF
23	VITE M6x35	Screw M6	A2
24	MOTORE	Motor	-
25	TAPPO RICEP.	Filter cap	PP/PVDF
26	TAPPO DRENAGGIO	Drain cap	PP/PVDF

\* PER MOTORE G90, G200 / For G90, G200 motor

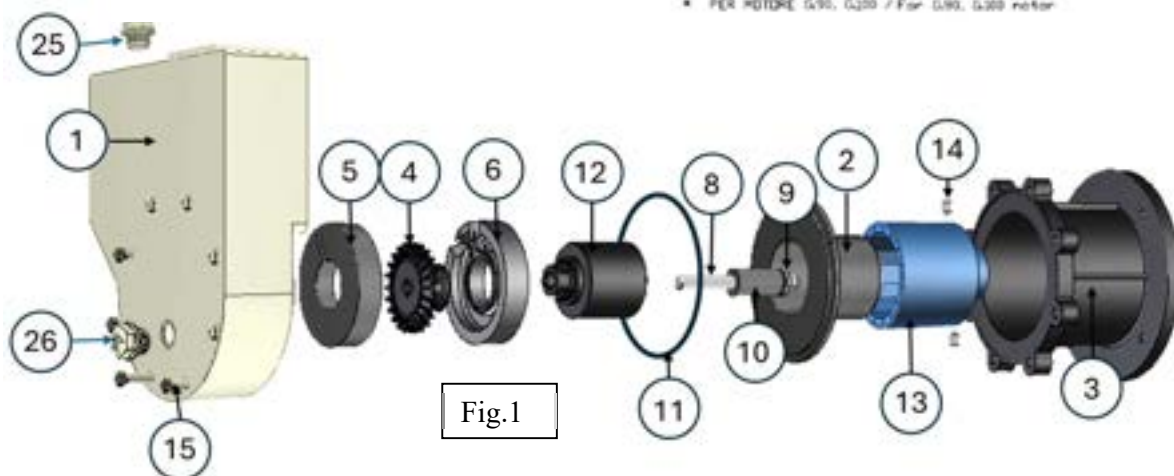


Fig.1



## 4.4 Disassembly

### 4.4.1 Procedure Before Disassembly



**ATTENTION:** If the pump has pumped hot liquids, make sure it has cooled down before proceeding with disassembly. The pump may have pumped toxic and/or dangerous liquids: it is therefore necessary to wear skin and eye protection.



**ATTENTION:** Be sure you have thoroughly purged the pump. Thoroughly flush and neutralize hazardous fluids inside the pump. The liquid must be recovered and disposed of according to existing environmental laws. After having disconnected the suction and delivery pipes, close the ends.



**ATTENTION:** GemmeCotti pumps contain extremely strong magnets. The use of non-ferrous magnetic tools and worktops is highly recommended. Beware of strong magnetic attraction when disassembling / reassembling the pump motor-outer magnet assembly.



The area where maintenance is performed must be clean and free of ferrous particles which can be attracted to the magnets.



**ATTENTION:** Wearers of PACE MAKER or equivalent devices cannot operate on the pump or near it due to the presence of strong magnetic fields.



**ATTENTION:** It is recommended not to operate near the magnets wearing wrist watches, bracelets, rings and ferromagnetic jewels and/or with electronic equipment sensitive to magnetic fields .

### 4.4.2 Disconnection of the pump from the motor

NB: The images used for disassembly operations refer to a particular model of the HTT-SP family and therefore the pump supplied to you may slightly differ from what is shown

Sequence of operations:

1. Remove the screws (18), nuts (20) and washers that tighten the pump with the motor flange
2. Separate the pump from the motor
3. If it is necessary to remove the external magnet (13) from the motor shaft, proceed by unscrewing the two grub screws (14) with an Allen key and then use an extractor so as not to damage the motor shaft or the external magnet.

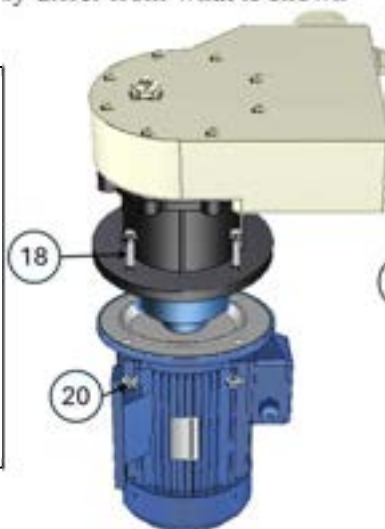


Fig.2

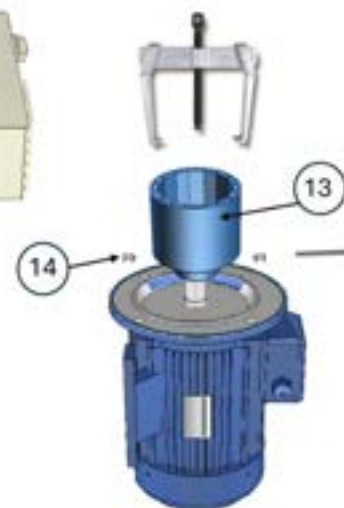


Fig.3

### 4.4.3 Disassembling Pump Components

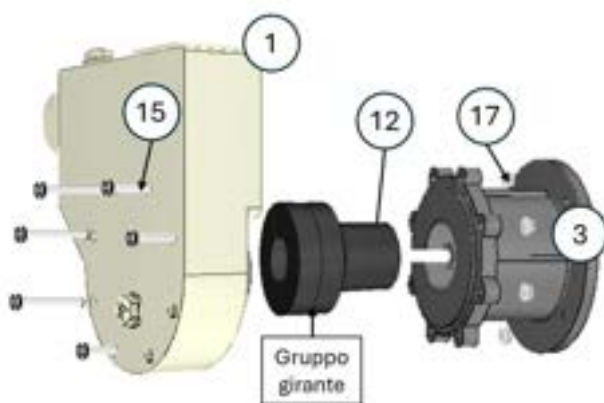


Fig.4

Sequence of operations:

1. Separate the pump casing (1) from the lantern (3), removing the screws (15) from the nuts (17) with their respective washers
2. Slide out the inner magnet (12) with the impeller assembly (Fig4)



3. Check the shaft (8) and ring (9) for wear  
*Be careful that the shaft and ring are made of ceramic material and therefore very fragile.*
4. Then remove the socket (9) and replace the external O-ring seal (11). (Fig.5)


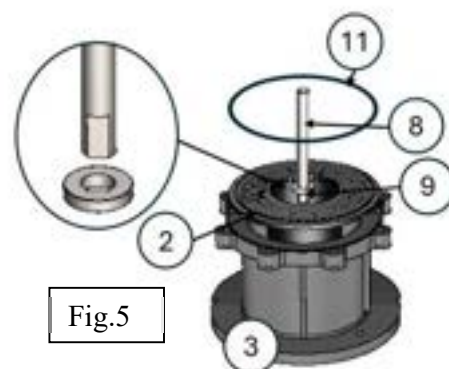


Fig.5

#### 4.4.4. Internal disassembly of the pump



5. Separate the Internal Magnet Assembly (GMI) (12) from the impeller assembly. (Fig.6)
6. Check the state of wear of the bushing (10) inside the GMI (12) (Fig.7)  
*The bushing (10) is mounted with slight interference inside the GMI. To reassemble it, simply use a manual press.*

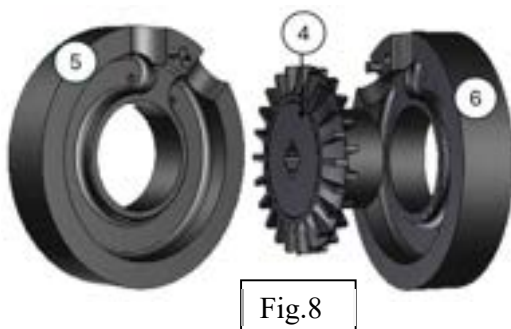

7. Separate the static discs (5) and (6) to access the impeller (4). Fig.8



**NOTE:** The components that can be replaced periodically are:

- O-ring (detail 11 in the exploded view drawing)
- Bushings (detail 10 in the exploded view)
- Static disks (detail 5-6 in the exploded drawing)

#### 4.5 Pump Reassembly

The assembly sequence mirrors the disassembly sequence, however the following warnings must be kept in mind:

**ATTENTION:**

Thoroughly clean each component before assembly, make sure that all parts are free of dirt, metal particles etc. Replace all O-rings



Place the external magnet on the motor shaft and send it to the stop. Then screw in the appropriate grub screws



When inserting the pump on the motor, pay attention to the magnetic adhesive force that can cause damage to your fingers or hands.




make sure that when the pump is closed, the O-ring (11) is perfectly seated and is not



Always check that the bushes are correctly seated and if necessary use a manual press to ensure that they are completely inserted into the seat



When mounting the impeller assembly on the pump housing (1), align the locating pin inside the pump housing with the groove of the front static disc (5)



Use torque wrenches for correct tightening force of the screws according to the table in paragraph 4.7 below.



after having tightened the pump on the motor flange, momentarily remove the protective shield of the impeller on the rear of the motor and rotate the impeller by hand to check the free rotation of the assembly thus created. If excessive friction or anomalous noises are detected, proceed with the disassembly of the assembly (operations in paragraph 4.4) and eliminate the cause of the anomaly. Under no circumstances proceed to use the pump without having carried out this check.

#### 4.6 Replacing the motor

Proceed as indicated in paragraph 4.4.2 above. Make sure that the characteristics of the motor are the same as the motor being replaced. The engine manufacturer may be different from the one previously fitted.

#### 4.7 Tightening Torques

The recommended tightening torques are shown in the table below:

THREAD	COUPLING TYPE	
	PLASTIC / PLASTIC PLASTIC / METAL	METAL / METAL
M5	3 Nm	8 Nm
M6	6 Nm	13 Nm
M8	10 Nm	32 Nm
M10	17 Nm	65 Nm
M12	25 Nm	110 Nm
M16	50 Nm	290 Nm

## 5. PROBLEM SOLUTIONS

<div> <div>1 Motor overload</div> <div>2 Insufficient flow velocity at pressure in the pump</div> <div>3 Leak of pressure on the discharge side</div> <div>4 Liquid outlet remains flow</div> <div>5 Noise and Vibration</div> <div>6 Pump clogged</div> <div>7 Overheating the Pump</div> <div>8 Abnormal wear</div> <div>9 Leak in the pump</div> </div>									
Problem									
	•		•						
	•	•	•	•					
		•							
	•		•	•					
	•		•	•					
		•	•	•					
	•			•					
	•								
	•			•	•	•	•		
	•			•	•	•			
				•	•	•	•		
		•							
	•								

Possible cause	Solution
Incorrect direction of rotation of the motor	Reverse the direction of rotation
Insufficient suction (NPSH)	Increase NPSH availability: <ul style="list-style-type: none"> <li>• Increase the suction reserve (positive head)</li> <li>• Lower the pump</li> <li>• Increase the diameter of the suction hose</li> <li>• Shorten or make the suction hose direct</li> </ul>
The pump is clogged	Clean the pump
Cavitation	Increase the available suction NPSH
The pump sucks in air	Check that the suction hose joints are tight
The suction hose is blocked	Check the valves and filters on the suction line
Discharge pressure is too strong	Reduce thrust by increasing pipe diameter and/or reducing the number of valves or bends
Flow velocity too high	Reduce Flow: <ul style="list-style-type: none"> <li>• Partially close the pressure valve</li> <li>• Reduce the rotation speed</li> </ul>
Liquid temperature too high	Cool the liquid
Incorrect material of the o-ring x the pumped liquid	Fit an O-ring of different material (contact us)
Impeller rubs	<ul style="list-style-type: none"> <li>• Reduce the temperature</li> <li>• Adjust the distance between the impeller and the glass or body</li> </ul>
Foreign objects in the liquid	Use a filter in the suction circuit
Closing the valve on the suction side	Check and open the valve
Discharge pressure too low	Increase the pressure: <ul style="list-style-type: none"> <li>• Install impeller with larger diameter (contact GemmeCotti)</li> </ul>

## 6. SPARE PARTS & ACCESSORIES

### 6.1 How to order spare parts and accessories

A complete series of spare parts and accessories are available from our warehouse and our distributors. To request spare parts and/or accessories, you must provide the model of your pump, the size, the material, the serial number, the year of construction and the number of the spare part required. These references can be found directly on the pump plate and on the cross-section drawings relating to the pump itself. If you do not have the drawings in the section, contact the GemmeCotti sales office (tel. +39 0296460406).




To find out in detail the available accessories, refer to the QR above or check our website [www.gemmecotti.com](http://www.gemmecotti.com)

## 7. DATA

### 7.1 Performance curves


CURVE 50HZ - 2900 RPM

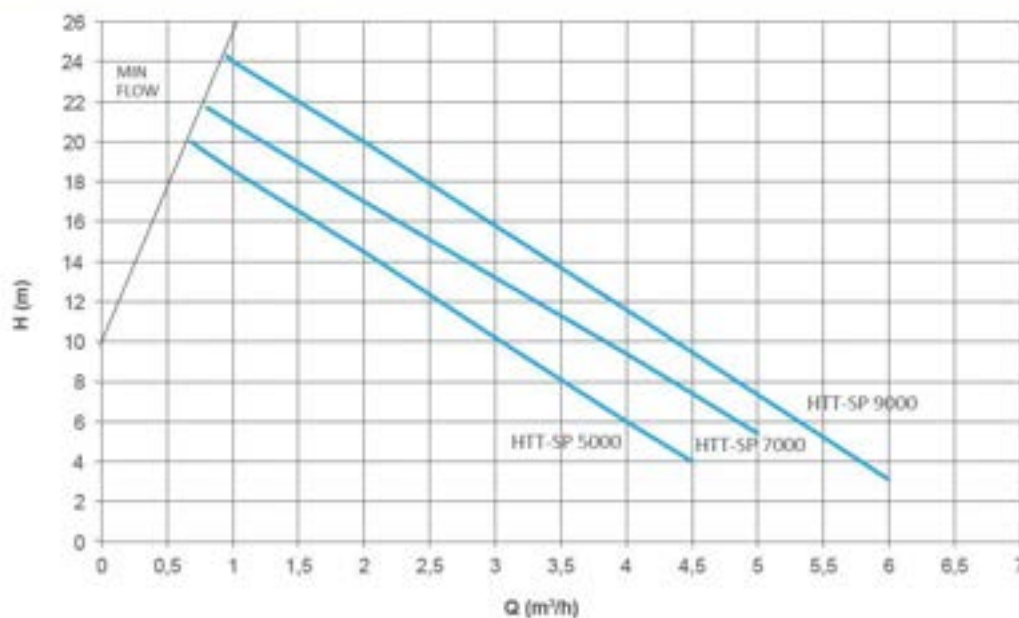



## 7.2 Dimensions

### HTT-SP DIMENSIONI

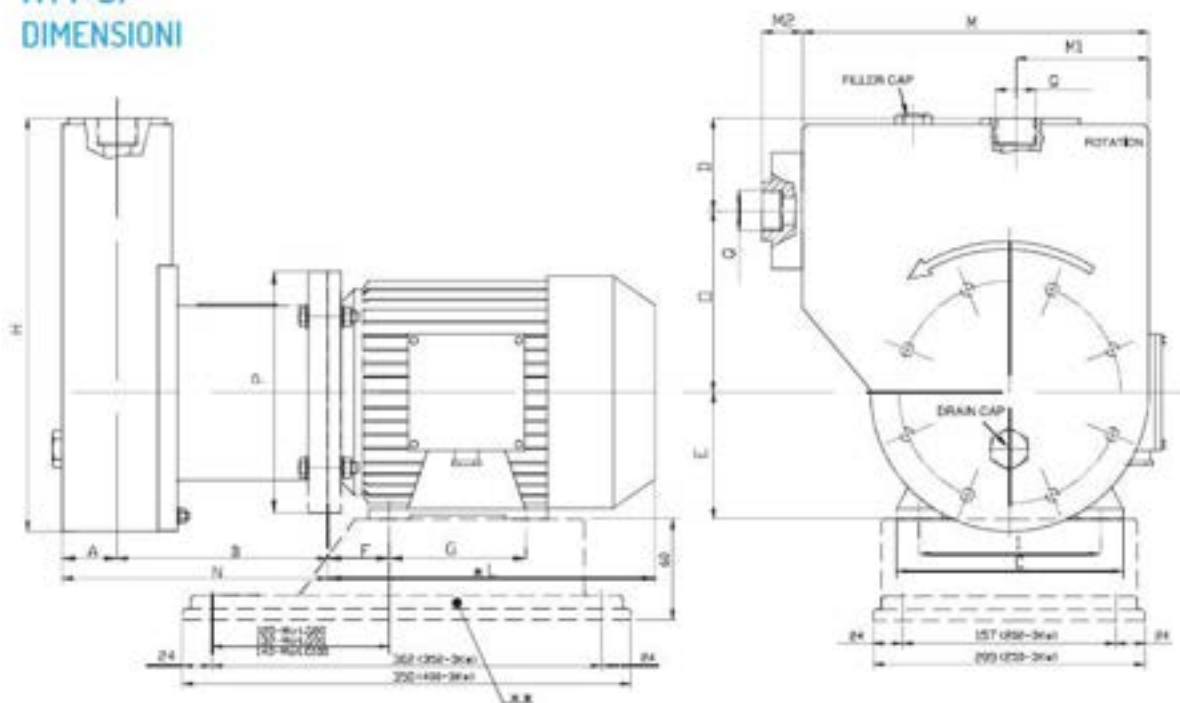

POMPA	FLANGIA MOTORE B3 - B5	KW	DIMENSIONI - mm -																	
			A	B	C	D	E	F	G	H	I	J	K	L	M	M1	M2	N	O	P
HTT-SP 5000	80	0.75	PP + 45 PVDF + 41	175	160	70	80	50	100	325	125	215	270	97.5	33	PP + 220 PVDF + 216	147	200	17	F FEMMINA
		232																		
HTT-SP 7000	80	1.1	PP + 45 PVDF + 41	175	160	70	80	50	100	325	125	232	270	97.5	33	PP + 220 PVDF + 216	147	200	17	F FEMMINA
		255																		
HTT-SP 9000	80	1.5	PP + 45 PVDF + 41	175	170	70	90	56	125	325	140	280	270	97.5	33	PP + 220 PVDF + 216	147	200	17	F FEMMINA
		280																		
HTT-SP 9000	80	2.2	PP + 45 PVDF + 41	175	170	70	90	56	125	325	140	280	270	97.5	33	PP + 220 PVDF + 216	147	200	17	F FEMMINA
		340																		
HTT-SP 9000	80	3	PP + 45 PVDF + 41	175	200	70	100	63	140	325	160	340	270	97.5	33	PP + 220 PVDF + 216	147	250	17	F FEMMINA
		340																		

## 7.3 Technical data and limits

The performance curves are valid for homogeneous liquids with specific gravity =1. If the liquid to be pumped has a specific gravity higher than 1, the absorbed power written on the performance curve has to be increased according to the value of the specific gravity of the liquid. For liquids having specific gravity higher than 2, please contact the GemmeCotti technical service (tel. +390296460406; e-mail [info@gemmecotti.com](mailto:info@gemmecotti.com)).

The performance curves are valid for homogeneous liquids having viscosity of 1CPS. If the pumped liquid has a viscosity different from 1 CPS the values of Q/H will be altered. The performance of the pump will decrease. For liquids having viscosity lower than 0.5 CPS or greater than 150 CPS please contact the GemmeCotti technical service.

Values of required NPSH written on the performance curves are the lower required values. As a rule, for safety reasons, the value of NPSH of the system (NPSH available) should be at least 1 m higher than the value of NPSH required (written on the performance curves) to prevent lack of lubrication or dry-running with consequent damage of the bearings.

NPSHa can decrease with the installation of a valve on the suction line. It is advisable to install a flow meter to check possible changes of value.

Values of performances written on the curves refer to trial pumps during prototype phase. In pumps manufactured in series such values can be lower. Usually these values have to be considered as follows:

- pumps with discharge up to 25mm: - 3 points
- pumps with discharge superior to 25mm: - 2 points

Characteristics of pumps series HTA are guaranteed by the manufacturer with tolerances in accordance with UNI EN ISO 9906:2002 regulation. With respect to other specifications or regulations requiring more restricted tolerances, these have to be specifically asked for at the moment of quotation; in this case GemmeCotti will choose a pump more suitable and the required regulations will be considered.

## 8. WARRANTY AND REPAIR

### 8.1 Warranty

All GemmeCotti products are guaranteed for a period of twelve (12) months starting from the delivery date of the goods.

For the warranty service to be applicable the customer must report the defect in writing no later than 8 (eight) days from the moment that the damage occurs, and must return the part (or parts) to GemmeCotti for repair or replacement. Pumps cannot be repaired or substituted on site. In the case of a request of warranty service, it's better to send the complete pump together with its motor to GemmeCotti.

The costs of delivery and the relative risks, and possible customs duties have to be paid by the customer. GemmeCotti will not accept the costs of collection and shipment.

The manufacturer is not responsible for damages caused during the shipment of the parts or of the pump sent to GemmeCotti to be repaired under warranty.

The warranty system provides that, after a careful examination at our factory, GemmeCotti is free to choose to repair or replace the part (or parts) of the pump which is/are defective in materials or in workmanship, or both. We will not give any refund or credit for the defective material or for direct or indirect damages caused by our pumps. In any case, any reimbursement cannot exceed the cost of the pump or of the supplied material.



If the pumped liquid and the needed performances have not been communicated to GemmeCotti before the offer and confirmed in the quotation and order confirmation and/or the pump is not properly installed, maintained and used for its intended purpose or under conditions which can reasonably be foreseen as indicated in the Machine Directive 2006/42/CE article 4 paragraph 1, the customer takes the whole responsibility for the usage of the product, especially if not used in an appropriate way, and the warranty, the conformity to the Machine Directive 2006/42/CE and the relative CE declaration are no longer valid. The proper installation, maintenance and use for its intended purpose and the conditions which can reasonably be foreseen are subject to the respect of the technical limits (temperature, working point, compatibility of the pump material with the pumped fluid, NPSH etc...) which are indicated in GemmeCotti's technical data files and use and maintenance manuals.

If the above mentioned limits are not respected, the customer is the only responsible for the introduction of the pump in the market, for the declaration of conformity to the Machine Directive and the CE mark. In any case the user is considered the one who knows better the chemical compatibility and the reactions between the liquid to be pumped and the material of construction of the pump and consequently the information given in this regard by GemmeCotti is merely indicative.

If the returned piece is no longer covered by guarantee, or if after inspection GemmeCotti finds the piece to be not defective, inspection charges will be charged to the customer and the repaired or substituted piece will be returned to the customer at the customer's own expense.

Pumps which have been repaired or substituted under guarantee will be supplied on the same delivery conditions as the order and the warranty will not be extended.

Warranty does not cover components subject to natural wear due to time, such as mechanical seals, bearings, bushings and lip seals.

The customer is solely responsible for the good performance of pumps and for their careful maintenance. Therefore no claims will be allowed when goods have been improperly handled (not stored in a suitable closed dry place, which is necessary because of the fragility of materials), contaminated, handled with negligence, improperly installed, tampered with or not well regulated, incorrectly used in wrong applications. In particular, GemmeCotti will not take any responsibility in the case of wear due to corrosion.

Ordinary maintenance and repair executed outside GemmeCotti authorized network, will cause invalidation of the warranty and of the CE declaration of conformity.

The warranty does not cover damages due to extraordinary or natural events, such as lightning, ice, fire and others.

All the warranty obligations are considered fully satisfied after the repair or substitution of the defective parts.

The Warranty service will be suspended in the case of default or delayed payment and the period lost cannot be recovered.

This warranty is an integral part of the offer and of the order confirmation.

In the case of litigation the court which has jurisdiction is the Busto Arsizio (Italy) Tribunal and the law that will be applied is the Italian Law.

## **8.2 Returned parts and repair**

All our distributors offer a complete repair service. Contact your local distributor or GemmeCotti s.r.l. directly.

Before sending the pump back to our repair services or to GemmeCotti, the pumps have to be decontaminated from the used dangerous liquids. Before sending the pump the customer has to fill in the Decontamination Declaration and send it by e-mail or fax as per the facsimile document in the next paragraph 8.3.

### 8.3 Decontamination Declaration <sup>3</sup> (facsimile)

**To: GemmeCotti S.r.l**  
Via PO 23/25/27 – 20031 Cesate (MI)  
Telephone 02. 964. 60. 406

SUBJECT: Decontamination Declaration of pumps to be repaired

Reference to our Transport document No: \_\_\_\_\_ dated: \_\_\_\_\_

Type of pump: \_\_\_\_\_ Serial Number: \_\_\_\_\_

Fluid pumped: \_\_\_\_\_

Type of problem/damage: \_\_\_\_\_

In accordance with current requirements regarding the health and safety of workmen, we hereby declare that:

1. The pump has been carefully cleaned and decontaminated to remove all traces of the pumped fluid
2. Also the residual fluid used to decontaminate the pump has been removed
3. It is possible to proceed with the repair of the pump without risks for the workmen or the environment

*Attention: if the pump is not correctly cleaned or we do not receive this document duly filled in, it will be sent back at the customer's expense*

Date \_\_\_\_\_

STAMP AND SIGNATURE

---

<sup>3</sup> TO BE COMPLETED ON THE CUSTOMER'S LETTERHEAD

## 8.4 CE CERTIFICATE FOR PUMPS SERIES HTT

**Declaration of conformity** <sup>4</sup> (facsimile)  
to the Machinery Directive 2006/42/EC

### **CE DECLARATION OF CONFORMITY**

We declare under our sole responsibility that the pump:

Brand: GEMMECOTTI

Type:

Model:

Serial Number:

Year:

as per described in attached documentation, is in accordance with the Machine Directive CE 2006/42 (ex 89/392/CEE - 91/368/CEE - 93/44/CEE – 93/68/CEE- 98/37 CEE) only if it's used for the liquids communicated by the customer..... and for the pump characteristics required with regard to the order No.....dated.....

If the pumped liquid and the needed performances have not been communicated to GemmeCotti and/or the pump is not properly installed, maintained and used for its intended purpose or under conditions which can reasonably be foreseen, the customer takes the whole responsibility of the products as indicated in our warranty Mod. 1.11.4E.

The conformity to the previously mentioned requirements is expressed by the marking:



ENRICO GEMME  
(Managing Director)

CESATE , date .....

Signature

<sup>4</sup> In cases where the customer does not communicate the type of liquid used in the pump and the expected operating conditions, the EC Declaration of Conformity will not be issued and the customer will assume the responsibility and burden of providing for the Certification of the pump in its application.

## 8.5 ATEX/CE Certificate for Zone 2 (facsimile)



### EU Declaration of conformity

The magnetic drive pump type:

SN

Together with all the pumps series:

EM(-C-T-P) PP/PVDF

bearing the mark:

**CE Ex II 3G Ex h IIB T6 Gc**

models:

EM-C 6 PP/PVDF, EM-C 10 PP/PVDF, EM-C 15 PP/PVDF, EM-C 31 PP/PVDF, EM-C 40 PP/PVDF, EM-C 50 PP/PVDF, EM-T 2000 PP/PVDF, EM-T 3000 PP/PVDF, EM-T 5000 PP/PVDF, EM-T 7000 PP/PVDF, EM-T 9000 PP/PVDF, EM-T 12000 PP/PVDF, EM-T SP 5000 PP/PVDF, EM-T SP 7000 PP/PVDF, EM-T SP 9000 PP/PVDF, EM-P 100 PP/PVDF, EM-P 200 PP/PVDF, EM-P 300 PP/PVDF, EM-P 400 PP/PVDF, EM-P 600 PP/PVDF, EM-P 800 PP/PVDF

have been manufactured by GemmeCotti s.r.l. in accordance with the following EC directives:

2014/34/EU (ex 94/9 EC), 2006/42 EC

and the following standards:

EN 12100, EN 13857, EN 809, EN 1127-1, EN 80079-36, EN 80079-37

The manufacturing process is internally controlled by a Quality Management System according to ISO 9001:2015 standards and the internal control of production file n. 101 ext. 01/07, is deposited at CIESI, notified body N.0722.

This declaration of conformity is issued under the sole responsibility of the manufacturer.



ATTENTION! The above magnetic drive pumps, considered as components, comply by design with the directive providing that installation is correctly performed by the manufacturer of the machinery. The pump must not be put in duty until the machinery or plant into which it has been incorporated is declared in conformity with the Machinery Directive. This declaration does not imply any warranty of properties. The safety instruction of the accompanying product documentation must be observed.

Since there is an endless variety of products and chemical compositions that can be suitable to be processed by the considered devices, the end user is the only responsible to verify the reactions and suitability with materials used to build the pump. Therefore, all necessary tests and checks must be performed with great care to avoid any risk, and any adverse event that cannot be foreseen by the manufacturer and of which the manufacturer cannot be held responsible, every dispute lies within competence of Italian Court.

Enrico Gemme  
General Manager

Cesate, Date: \_\_\_\_\_



Via Po 23-25-27 - 20031 - Cesate (MI) ITALY - EU

[www.gemmecotti.com](http://www.gemmecotti.com)

Tel. +39 02 96460406 - [info@gemmecotti.com](mailto:info@gemmecotti.com)

libel 8.2.1 (4/17)